


AIR RELEASE VALVE MODEL S-050-C-V BY ARI
 FLOW CONTROL WITH ONE WAY CHECK VALVE
 ON AIR OUTLET TO PREVENT AIR AND WATER
 FROM ENTERING UNDER VACUUM CONDITIONS.
 AIR RELEASE VALVE SHALL BE ATTACHED TO A
 1" BRASS BALL VALVE (FORD B11-444)

PLAN

HDPE SIGMA BOX RMB 173018NSW-W
 AND COVER N1730BLKWAT

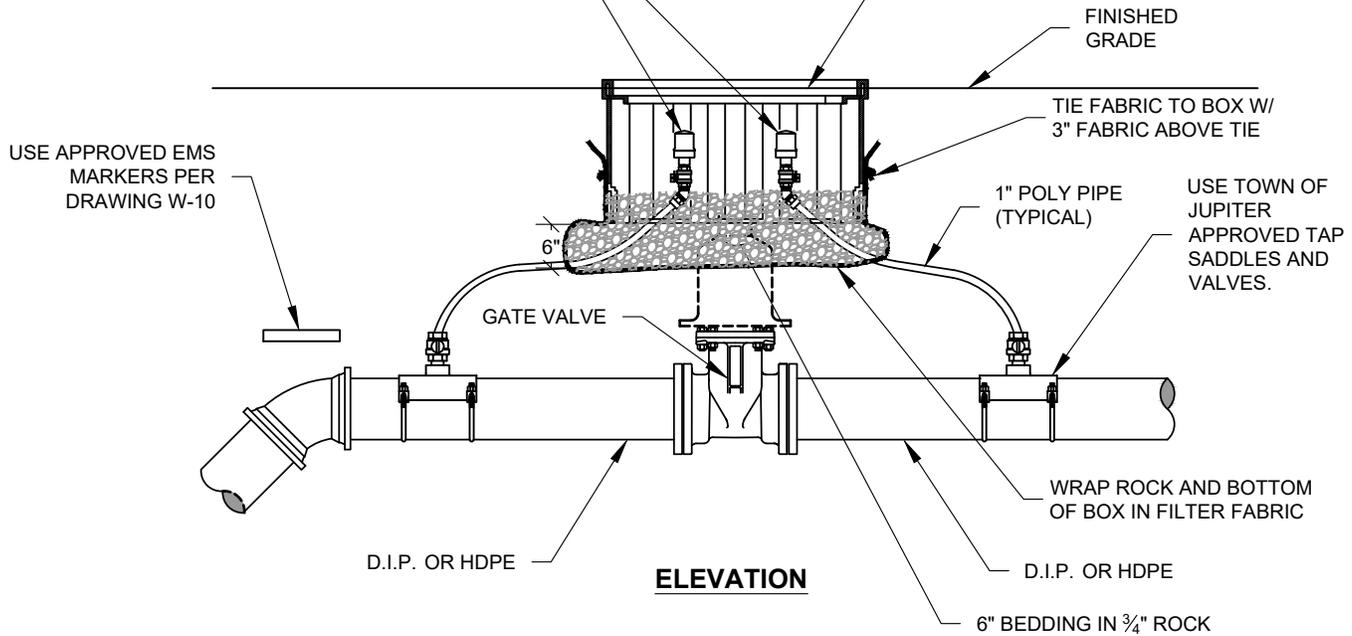

NOTES:

1. INSTALL ALL GATE VALVES, TAP SADDLES, AIR RELEASES EMS MARKERS, VALVE AND GOLF BOXES PER TOWN OF JUPITER CONSTRUCTION STANDARDS.
2. ALL MATERIAL SHALL BE APPROVED BY THE TOWN OF JUPITER WATER UTILITIES PRIOR TO INSTALLATION.

NOT TO SCALE

SUBAQUEOUS CROSSING TESTING AND AIR RELEASE PIT

JUPITER UTILITIES
 CONSTRUCTION STANDARDS AND DETAILS

DATE APPROVED:
 12/2021
 DRAWING No. **W-31**