


* 12" REQUIRED, MAY BE REDUCED TO 6" MINIMUM FOR WATERMAIN OVER GRAVITY OR VACUUM - TYPE SANITARY SEWER OR STORM DRAIN IF APPROVED IN WRITING BY THE TOWN OF JUPITER.


DEFLECTION OVER CONFLICT

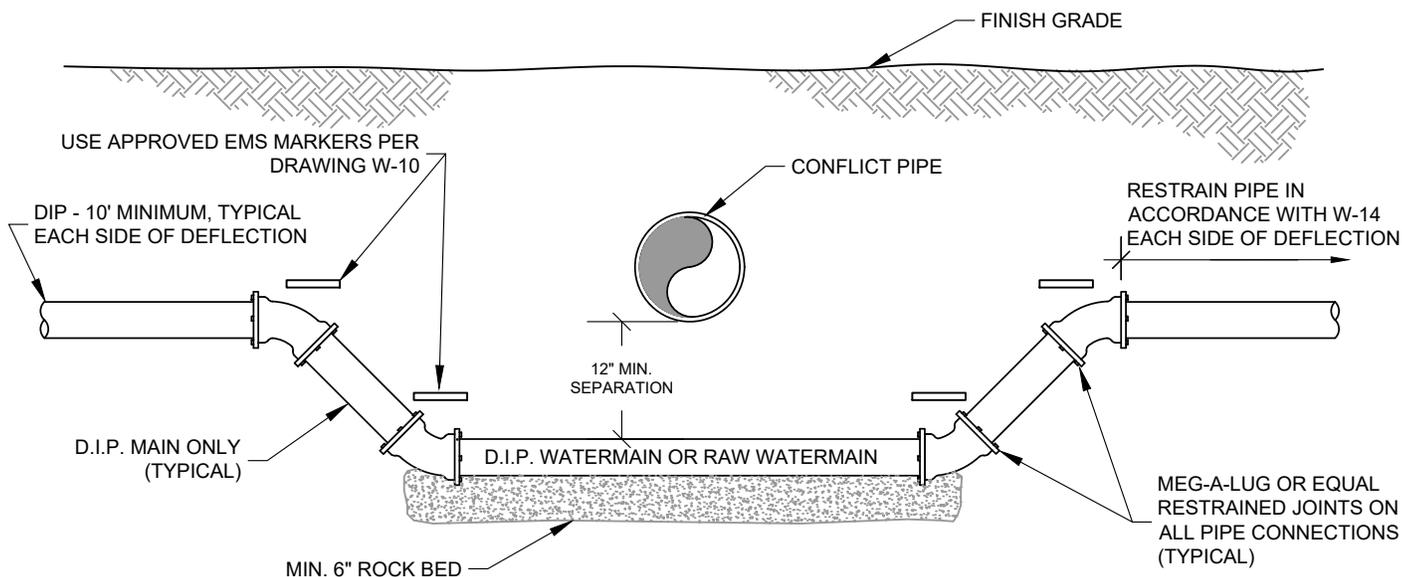

DEFLECTION UNDER CONFLICT

NOTES:

1. MINIMUM COVER MAY BE REDUCED ONLY IF APPROVED BY THE TOWN OF JUPITER UTILITIES DEPARTMENT
2. USE APPROVED E.M.S. MARKERS PER DRAWING W-10
3. THE CROSSING SHALL BE ARRANGED SO THAT THE CONFLICT PIPE JOINTS AND THE POTABLE WATERMAIN JOINTS ARE EQUIDISTANT FROM THE POINT OF CROSSING. TEN (10) FEET OR HALF A FULL JOINT OF PIPE (DIP FOR WATERMAIN) SHALL BE BETWEEN THE CONFLICT AND THE JOINTS ON BOTH PIPES.
4. MUST MEET FDEP REQUIREMENTS ACCORDING TO SECTION 62-555-314, LOCATION OF PUBLIC WATERMAIN SYSTEMS.

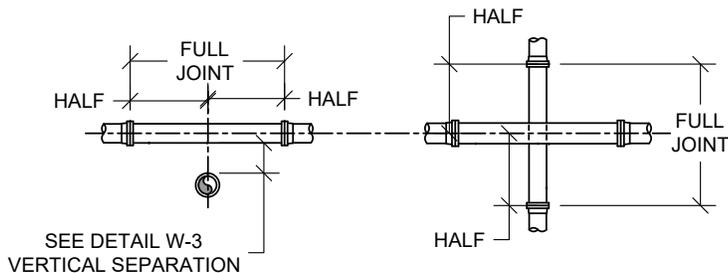

TYPICAL SECTION - WATER MAIN DEFLECTION