


CASE # 1


WATERMAIN PARALLEL TO
STORMSEWER, STORMWATER
FORCE MAIN OR RECLAIMED
WATER (RECLAIMED WATER
REGULATED UNDER PART III OF
CHAPTER 62-610, F.A.C.)

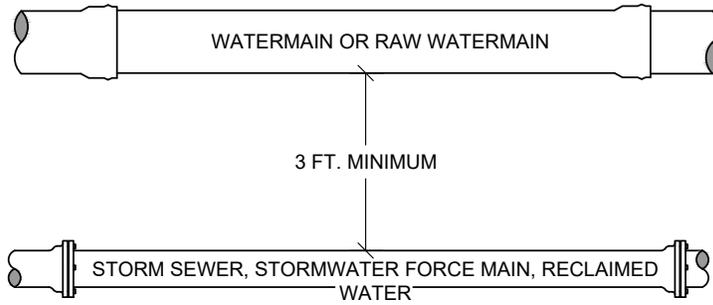

NOTE: CASE # 1 SHALL BE USED FOR ALL UNDERGROUND ELECTRICAL UTILITIES, TELECOMMUNICATION UTILITIES, GAS UTILITIES AND OTHER CONDUITS, CABLE, WIRE ETC.

CASE # 2


WATERMAIN PARALLEL TO VACUUM
SANITARY SEWER

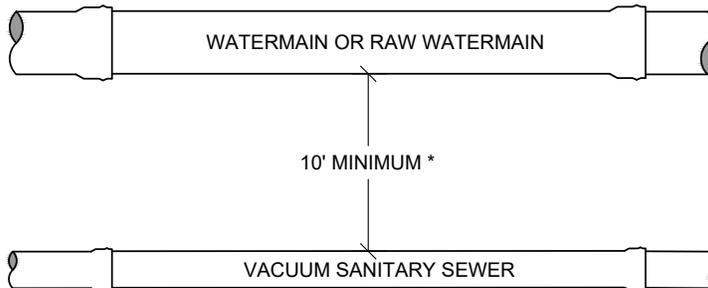

* MAY BE REDUCED TO THREE (3) FEET IF APPROVED IN WRITING BY THE TOWN OF JUPITER.

CASE # 3

WATERMAIN PARALLEL TO GRAVITY
OR PRESSURE SANITARY SEWER,
SANITARY SEWER FORCE MAIN,
RECLAIMED WATER (RECLAIMED
WATER NOT REGULATED UNDER
PART III OF CHAPTER 62-610,
F.A.C.)

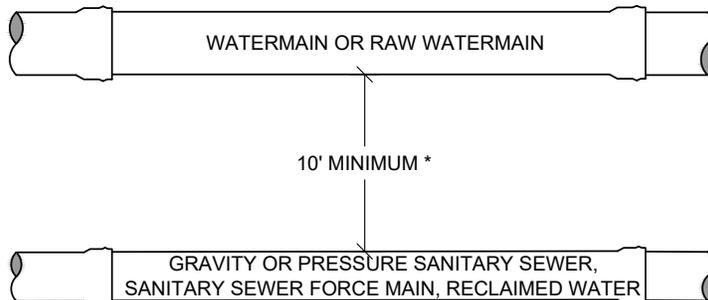

* 3' FOR GRAVITY SEWER WHERE THE BOTTOM OF THE WATERMAIN IS LAID AT LEAST 6" ABOVE THE TOP OF THE GRAVITY SEWER.

WATER MAIN HORIZONTAL SEPARATION