


REDUCED PRESSURE ZONE (RPZ) BACKFLOW PREVENTION ASSEMBLY FOR $\frac{3}{4}$ " , 1" , 1- $\frac{1}{2}$ " , AND 2" INSTALLATIONS

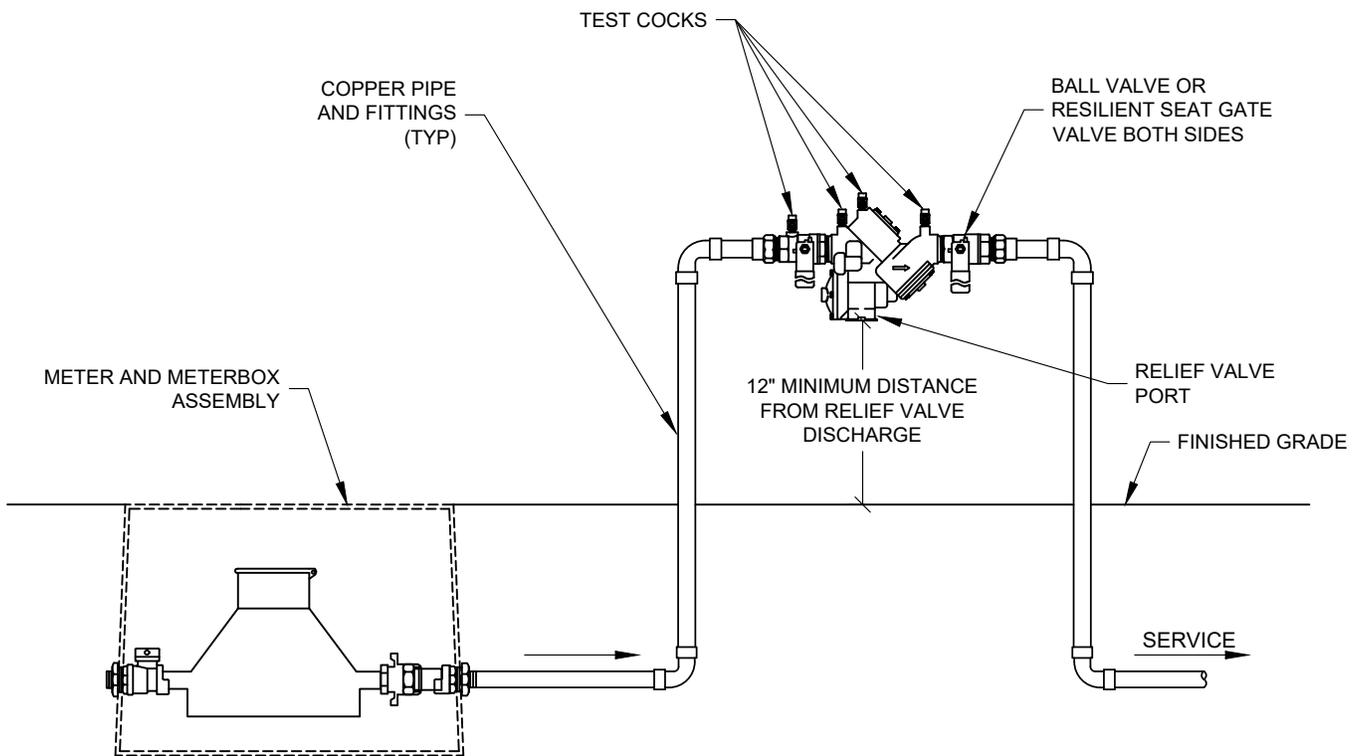

NOT TO SCALE

NOTES:

1. ALL BRASS FITTING MATERIAL INSTALLED SHALL CONTAIN NO LEAD IN ACCORDANCE WITH THE CURRENT DRINKING WATER STANDARDS.
2. THE BACKFLOW PREVENTION DEVICE MUST BE CERTIFIED BY THE UNIVERSITY OF SOUTHERN CALIFORNIA HYDRAULIC RESEARCH.

REDUCED PRESSURE ZONE BACKFLOW PREVENTION ASSEMBLY

JUPITER UTILITIES
CONSTRUCTION STANDARDS AND DETAILS

DATE APPROVED:	04/2021
DRAWING No.	CC-1