



# REDUCED PRESSURE ZONE $\frac{3}{4}$ " , 1" , 1- $\frac{1}{2}$ " , AND 2" PARALLEL INSTALLATIONS

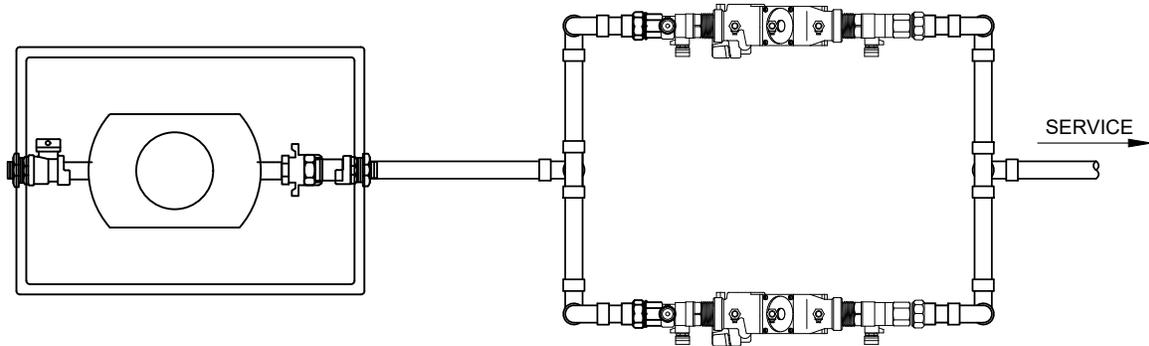

PLAN

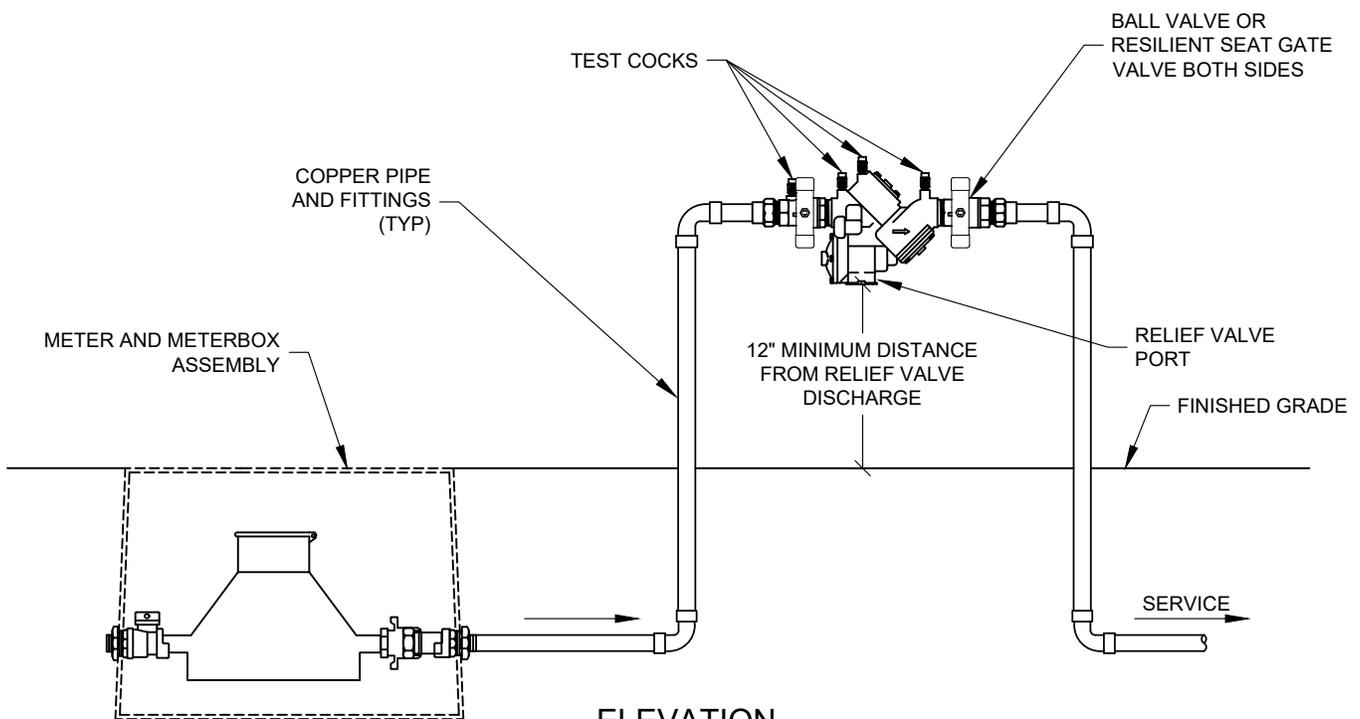

ELEVATION

NOT TO SCALE

NOTES:

1. ALL BRASS FITTING MATERIAL INSTALLED SHALL CONTAIN NO LEAD IN ACCORDANCE WITH THE CURRENT DRINKING WATER STANDARDS.
2. PARALLEL BACKFLOW DEVICE INSTALLATIONS SHALL BE USED WHERE CONTINUOUS FLOW IS REQUIRED DURING SERVICING AND/OR TESTING, OR WHERE A GREATER CAPACITY THAN A SINGLE UNIT IS NECESSARY.
3. THE BACKFLOW PREVENTION DEVICE MUST BE CERTIFIED BY THE UNIVERSITY OF SOUTHERN CALIFORNIA HYDRAULIC RESEARCH.

## PARALLEL REDUCED PRESSURE ZONE BACKFLOW PREVENTION ASSEMBLIES

**JUPITER UTILITIES**  
 CONSTRUCTION STANDARDS AND DETAILS

|                |         |
|----------------|---------|
| DATE APPROVED: | 04/2021 |
| DRAWING No.    | CC-3    |