



DOUBLE CHECK VALVE BACKFLOW ASSEMBLY

$\frac{3}{4}$ " , 1" , 1- $\frac{1}{2}$ " , AND 2" PARALLEL INSTALLATIONS

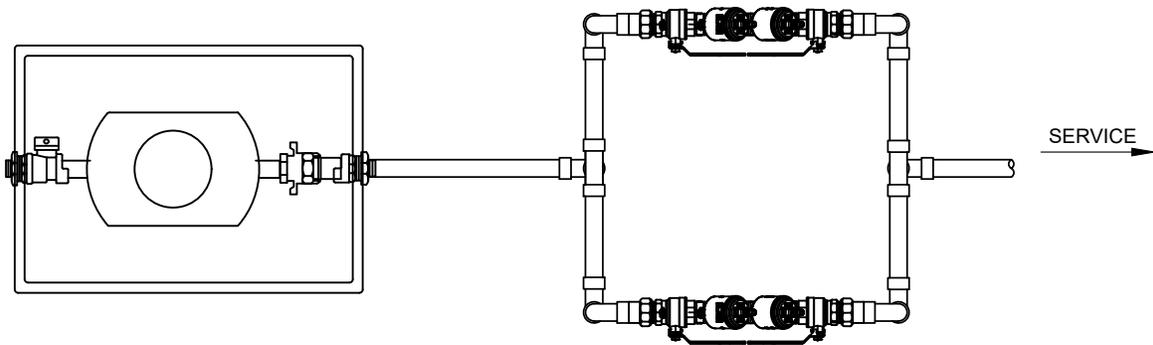

PLAN

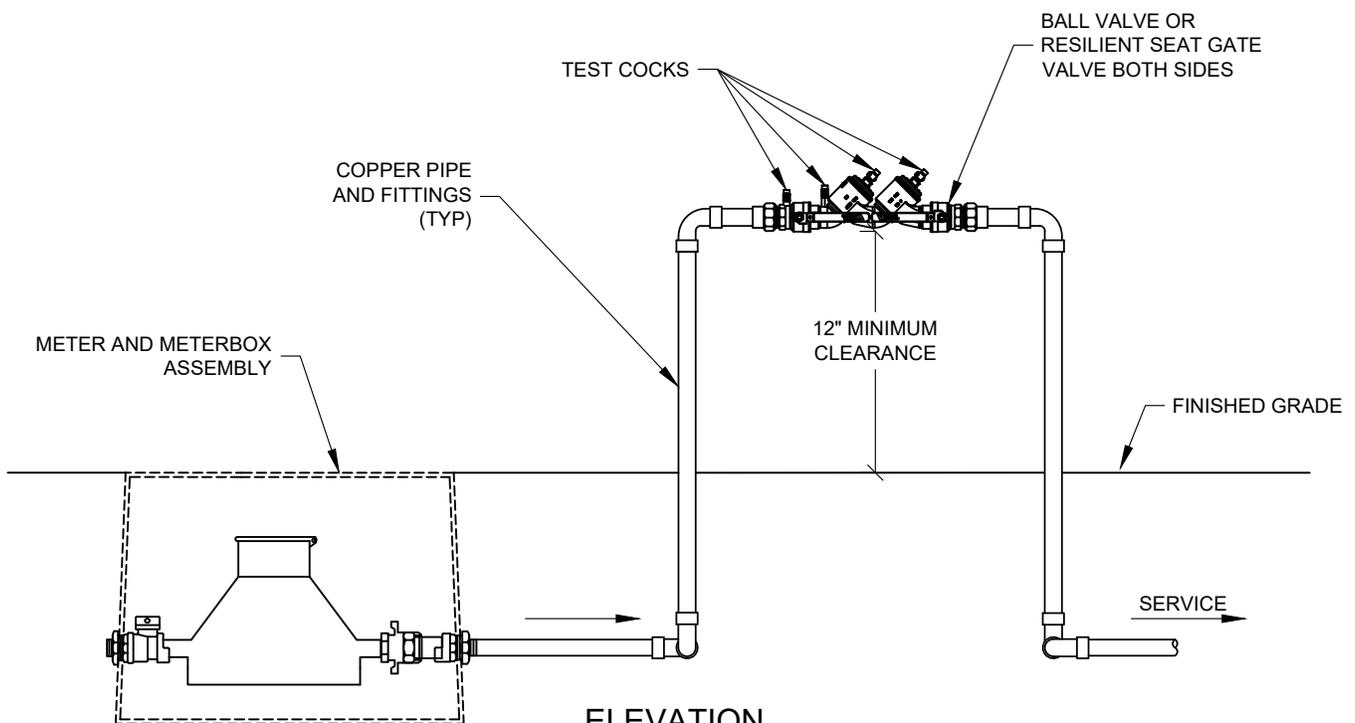

ELEVATION

NOT TO SCALE

NOTES:

1. ALL BRASS FITTING MATERIAL INSTALLED SHALL CONTAIN NO LEAD IN ACCORDANCE WITH THE CURRENT DRINKING WATER STANDARDS.
2. PARALLEL BACKFLOW DEVICE INSTALLATIONS SHALL BE USED WHERE CONTINUOUS FLOW IS REQUIRED DURING SERVICING AND/OR TESTING, OR WHERE A GREATER CAPACITY THAN A SINGLE UNIT IS NECESSARY.
3. THE BACKFLOW PREVENTION DEVICE MUST BE CERTIFIED BY THE UNIVERSITY OF SOUTHERN CALIFORNIA HYDRAULIC RESEARCH.

PARALLEL DOUBLE CHECK VALVE BACKFLOW PREVENTION ASSEMBLIES

JUPITER UTILITIES
CONSTRUCTION STANDARDS AND DETAILS

DATE APPROVED:
04/2021
DRAWING No. CC-4