


NOTES:

1. THE PRESSURE VACUUM BREAKER (PVB) SHALL BE INSTALLED ONLY ON SYSTEMS SUBJECT TO NO BACK PRESSURE.
2. THE PRESSURE VACUUM BREAKER SHALL BE INSTALLED IN AN ACCESSIBLE LOCATION FOR SERVICE AND INSPECTION.
3. THE PRESSURE VACUUM BREAKER SHALL BE INSTALLED IN THE MAIN LINE TO THE IRRIGATION SYSTEM, NOT LESS THAN 12 INCHES ABOVE THE HIGHEST SPRINKLER HEAD.
4. ALL MATERIAL SHALL BE APPROVED BY THE TOWN OF JUPITER WATER UTILITIES PRIOR TO INSTALLATION.
5. ALL BRASS FITTING MATERIAL INSTALLED SHALL CONTAIN NO LEAD IN ACCORDANCE WITH THE CURRENT DRINKING WATER STANDARDS.
6. THE BACKFLOW PREVENTION DEVICE MUST BE CERTIFIED BY THE UNIVERSITY OF SOUTHERN CALIFORNIA HYDRAULIC RESEARCH.

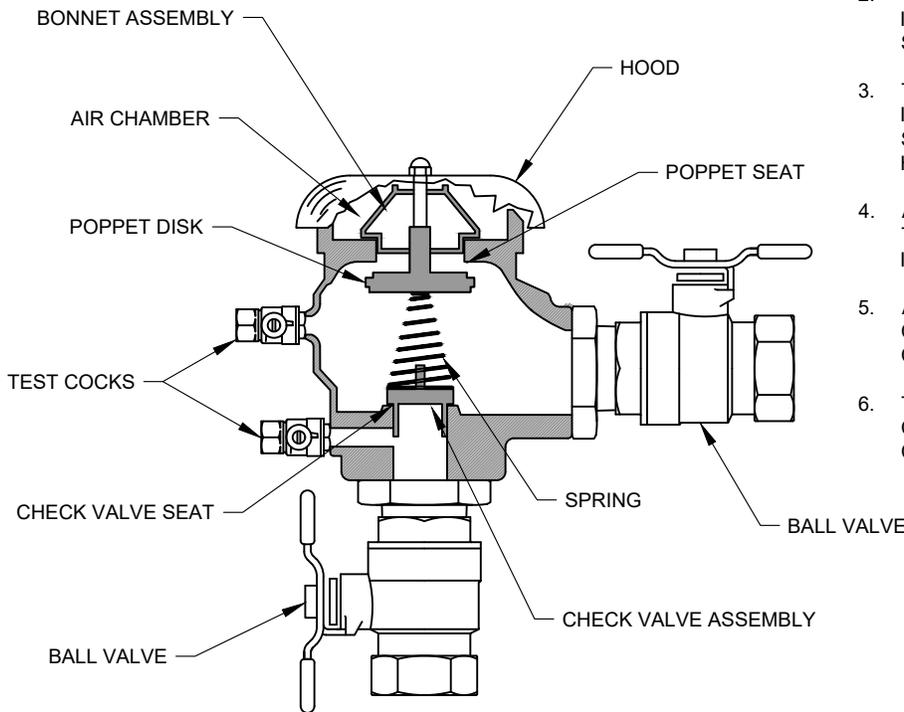

NOT TO SCALE

PRESSURE TYPE VACUUM BREAKER FOR POTABLE IRRIGATION

JUPITER UTILITIES
CONSTRUCTION STANDARDS AND DETAILS

DATE APPROVED:
04/2021
DRAWING No. CC-5