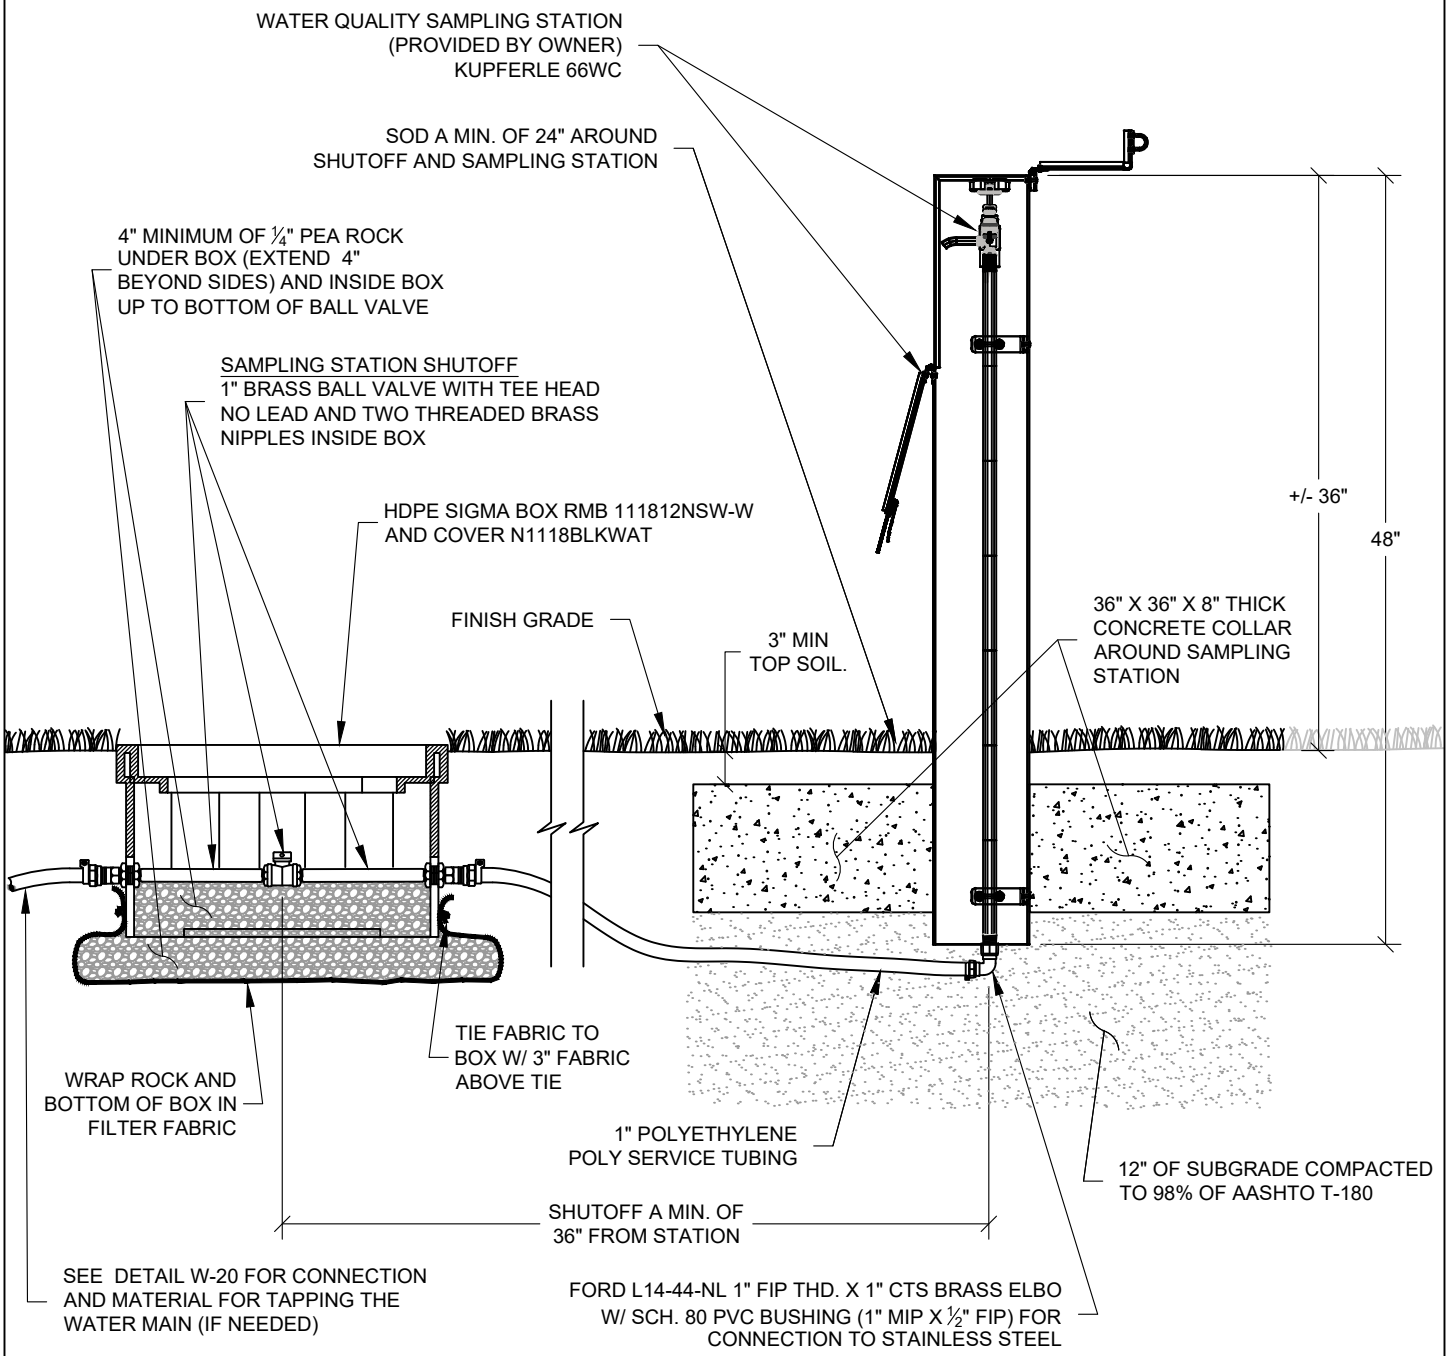

NOT TO SCALE

NOTES:

1. CONTRACTOR SHALL COORDINATE WITH TOWN OF JUPITER STAFF FOR THE FOLLOWING:
   - LOCATION OF THE WATER DISTRIBUTION SYSTEM
   - WATER MAIN CONNECTION AND MATERIAL (IF NECESSARY)
   - LOCATION OF WATER SERVICE SHUTOFF VALVE AND BOX
   - LOCATION AND ORIENTATION OF THE SAMPLING STATION
   - RESTORATION OF THE SITE
2. CONCRETE COLLAR MIX SHALL MEET A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI IN 28 DAYS.
3. ANY HARDSCAPE (CONCRETE/ASPHALT/PAVERS) REPLACEMENT SHALL BE EXISTING OR BETTER CONDITION PRIOR TO CONSTRUCTION.
4. SOD REPLACEMENT SHALL BE LIKE KIND AS EXISTED PRIOR TO SAMPLING STATION INSTALLATION.
5. ALL BRASS FITTING MATERIAL NOTED ABOVE OR PROVIDED FOR THIS INSTALLATION SHALL BE "NO LEAD" (-NL).

WATER QUALITY SAMPLING STATION

JUPITER UTILITIES

CONSTRUCTION STANDARDS AND DETAILS

DATE APPROVED: 12/2021

DRAWING No. W-32