




TYPE "F" CURB
N.T.S.

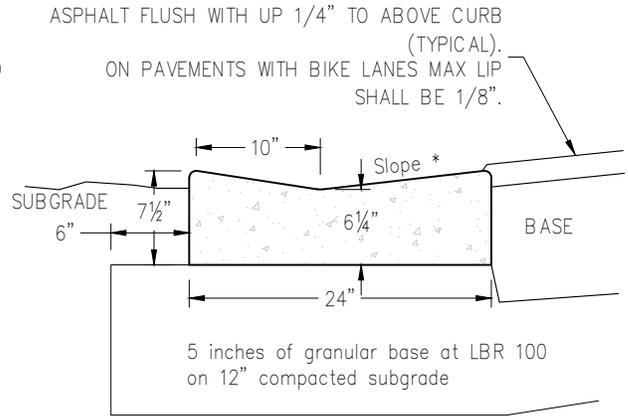

VALLEY GUTTER/DROP CURB
N.T.S.

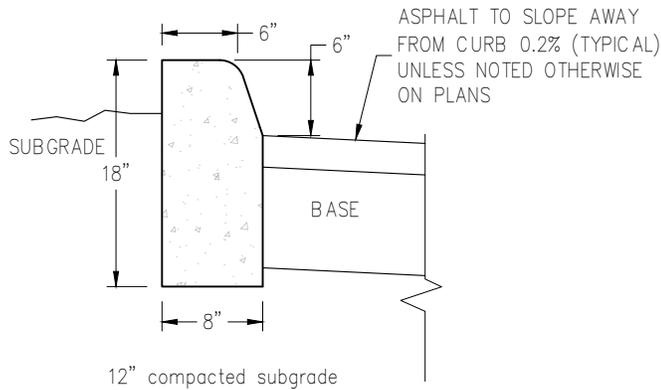

TYPE "D" CURB
N.T.S.

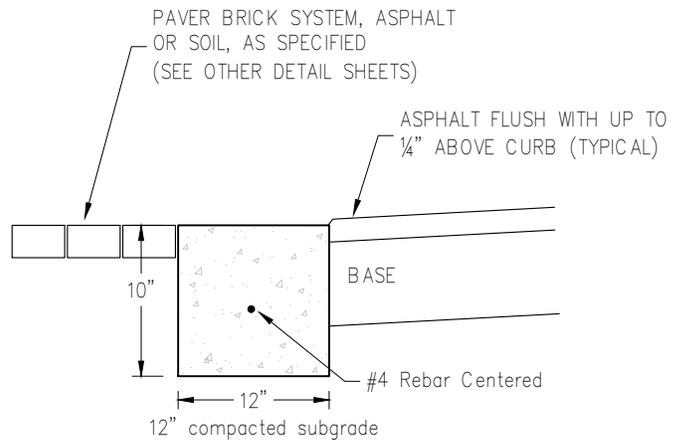

HEADER CURB
N.T.S.

NOTES:

1. When used on high side of roadways, the cross slope shall match pavement slope, and lip thickness shall be 6" minimum. (See FDOT Standard Plans Index 520-001)

- GENERAL NOTES :
1. SAWCUTS REQUIRED AT 10' CENTERS WITHIN 48 HOURS OF POUR FOR ALL CURB TYPES.
 2. ALL CONCRETE STANDARD MIX - MIN. 3000 PSI IN 28 DAYS
 3. REFER TO FDOT INDEX 300.
 4. 12" DEPTH SUBGRADE COMPACTION TO 98% MAX DENSITY PER AASHTO T-180.
 5. BASE COMPACTION TO 98% MAX DENSITY PER AASHTO T-180.



TOWN OF JUPITER
ENGINEERING DIVISION

210 MILITARY TRAIL
JUPITER, FLORIDA 33458
(561) 746-5134

TYPICAL CURBING
DETAIL AND REQUIREMENTS

V:\Engineering\Drawings\Details\2025\106 - curbtypical.dwg

DETAIL NUMBER

106

Revised 20250416